

# Certified Pure

The Breathing Air/Gas processed and analyzed  
on **04/25/12** satisfies the guidelines for

**CGA E, NFPA 1500 (G-7.1, '07)**

**ONTARIO CO. EMO**  
BAUER, STF

Kit# - 252951    Issue ID - 222640    Issue Date - 04/25/12

This Certificate is not issued for an unbounded duration. A regular testing program and quality control should be instituted to ensure continued compliance with the standard indicated above. This Certificate may not be reproduced except with the written permission of Lawrence Factor, Inc. Estimated Measurement of Uncertainty values for the reported analytes are available upon request.

COPYRIGHT © 1999 Lawrence Factor, Inc.

MAY - 3 2012

ONTARIO COUNTY  
EMERGENCY MANAGEMENT OFFICE

**ONTARIO CO. EMO**

NA

Test Site

BAUER, STF

ID #'s

Client ID: NA

Agent ID: PACI14206

**PACIFIC ENGINEERING INC.**

Program Information

Program #:

Frequency: Single

Kit #: **252951**

Tracking Information

Date Received: 04/23/12

Issue ID: 222640


**CGA E, NFPA 1500 (G-7.1, '07)**

Analytes	Test #1			Range
	04/25/12			
Oxygen (%)	21.2			20-22
Carbon Dioxide (ppm)	302.14			1000
Carbon Monoxide (ppm)	<1			10
T.H.C. (ppm)	<1			25
Water Vapor (ppm)	18.95			24
Dew Point (F)	-68			-65
Oil/Part. (mg/m3)	<1			5
Unknowns	ND			NA
Odor	ND			None

**Spectra #:** 222640.SPA

**Results:** Sample Meets Standard

S  
P  
E  
C  
T  
R  
A  
L  
  
R  
E  
A  
D  
O  
U  
T

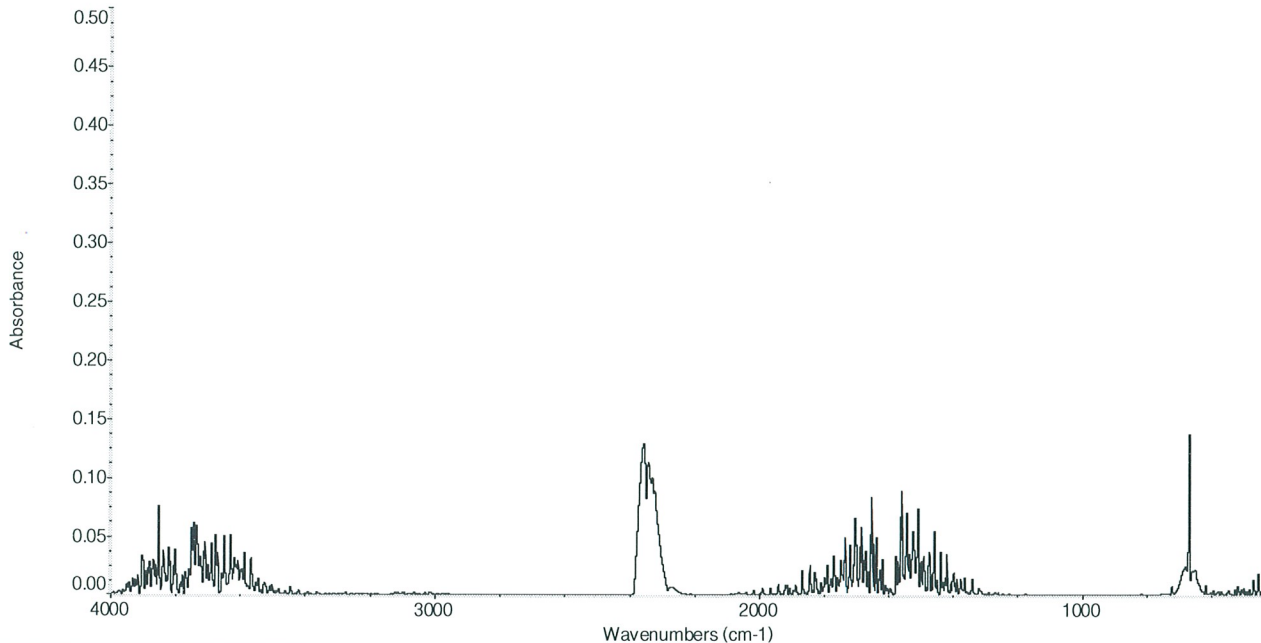

COPYRIGHT © 1999 Lawrence Factor, Inc.